

# Wide-Area Time Distribution with PTP Using Commercial Telecom Optical Fiber

NASPI Work Group Meeting  
March 22, 2017

Lee Cosart, [lee.cosart@microsemi.com](mailto:lee.cosart@microsemi.com)  
Microsemi Corporation  
Presenter, Co-author

Marc Weiss, [mweiss@nist.gov](mailto:mweiss@nist.gov)  
NIST Time and Frequency Division  
Co-author

# Outline

- Review of Motivation/History/Project Plan
- Boulder (NIST) to Schriever (USNO)
  - Transfer results using SONET, OTN
  - Asymmetry investigation
  - PTP fiber vs. GPS carrier phase
  - Long-term measurements
- Solving asymmetry – APTS – New Standard
- Next steps
  - Circuit from Boulder to Chicago

# Motivation

- Need to back up critical infrastructure for time at **microsecond ( $\mu\text{s}$ ) or better**
  - NTP over internet no better than  $\sim$  **1millisecond (ms)**
- Research use of public telecom networks to transfer time
  - Optical fibers excellent for two-way time transfer
  - Public network fiber rather than dedicated dark fiber
- Need a method that is commercially viable
  - IEEE 1588 (PTP) is a new standard for time transfer
  - Commercial equipment exists

# History of Project

- CenturyLink provider agreed in principle to two-year experiment linking NIST Boulder and USNO AMC at Schriever AFB (Source of UTC from GPS)
- DHS issued RFI, December 2011
- One vendor, Symmetricom-Microsemi, gave a detailed plan
- Tri-lateral MOU written: DoC (NIST)-DHS-DoD (USNO)
- Three-way Cooperative Research and Development Agreement (CRADA) NIST with CenturyLink and Symmetricom-Microsemi signed in January 2013
- **CRADA now extended to January 2019**

DHS: Department of Homeland Security


USNO: US Naval Observatory

DoC: Department of Commerce

AMC: Alternate Master Clock

DoD: Department of Defense

AFB: Air Force Base

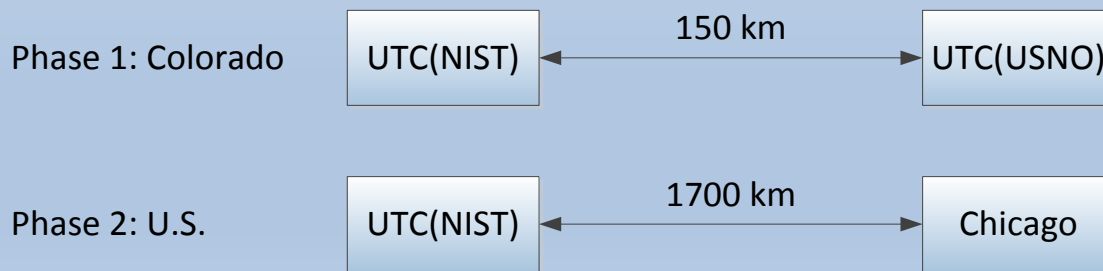


# NIST-AMC Timing Experiment

## Microsemi PTP + CenturyLink Circuit

- Microsemi provides PTP timing signals over Gigabit Ethernet
- CenturyLink provides two different circuits to carry the timing signals
  - STS over SONET with varied bandwidths on an OC-192
  - OTN on an ODU-0, within an ODU-2 transport

# Time Transfer Experiment

- Two-way time transfer using neighboring unidirectional fibers
  - No time-awareness anywhere in network
  - No routers in path
  - No real traffic, though traffic noise can be added
- Measurements at NIST and AMC against UTC(NIST) and UTC(USNO)

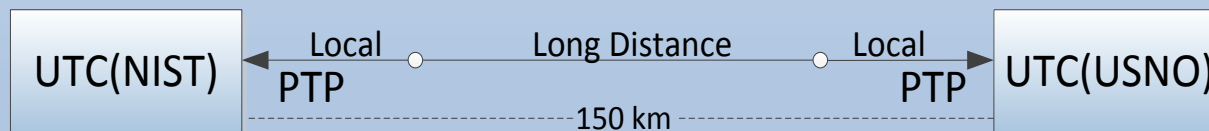


# PTP Over SONET/OTN

- April 2014 - July 2014: studied SONET
- July 2014 – present: studying OTN
  - Better performance
  - Better for studying asymmetry
- PDV measurements made in two directions
  - GM at USNO AMC and PTP probe at NIST
  - Forward means USNO AMC to NIST
  - Reverse means NIST to USNO AMC
- PTP over SONET vs. PTP over OTN
  - **Asymmetry:** Both show large asymmetry of 40  $\mu$ s between forward and reverse directions
  - **Delay:** Both show  $\sim$ 2 ms delay over 150 km of fiber
  - **Jitter:** SONET: 200 ns; OTN: <4ns
  - **Wander:** SONET: Variations on order of 300 ns; OTN: Usually close to 0 ns, occasional excursions 10's of ns

	Asymmetry	Delay	Jitter	Wander
PTP over SONET	40 $\mu$ s	2 ms	200 ns	300 ns
PTP over OTN	40 $\mu$ s	2 ms	< 4 ns	10's of ns

# Results from “Asymmetry” Experiment

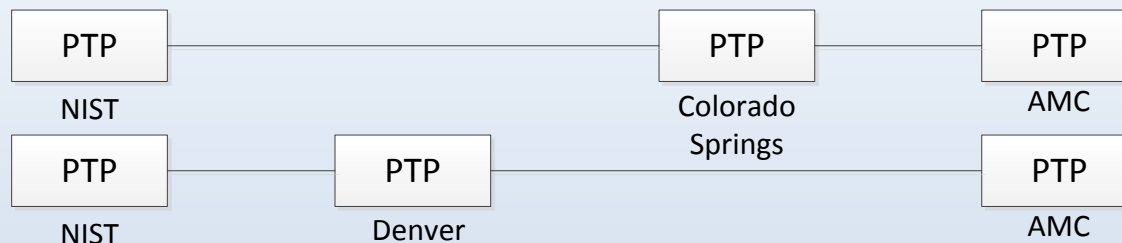

- Isolated sources of 40 microsecond asymmetry
  - Latency divided approximately equally between NIST-D, D-CS, CS-AMC
  - 75% of the asymmetry is accounted for by the Denver-Colorado Springs link


	AMC to NIST delay	NIST to AMC delay	Asymmetry
Direct circuit	2025 $\mu$ s	2066 $\mu$ s	40.5 $\mu$ s
Circuit broken in Colorado Springs	2270 $\mu$ s	2300 $\mu$ s	30.2 $\mu$ s
Circuit broken in Denver	2232 $\mu$ s	2278 $\mu$ s	46.5 $\mu$ s

- Two important points
  - When circuits are rebuilt, latency and asymmetry change (see table above)
  - **Asymmetry is static and can be calibrated out as long as the circuit stays up** (several measurements of two to three months or more have shown this to be the case)




# Asymmetry Step

Two-way time error steps from 20  $\mu$ s to 19.5  $\mu$ s after 18 days in 56-day measurement

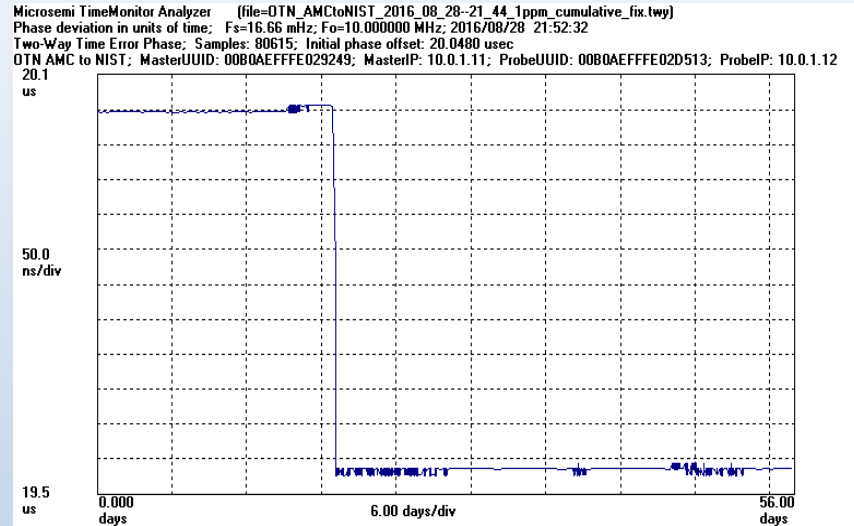


Close analysis of forward and reverse PDV flows shows the a 4 minute stoppage followed by each moving a different amount in opposite directions

*The Boulder-Schriever circuit went down for 4 minutes and then came back up with different latencies and asymmetry*

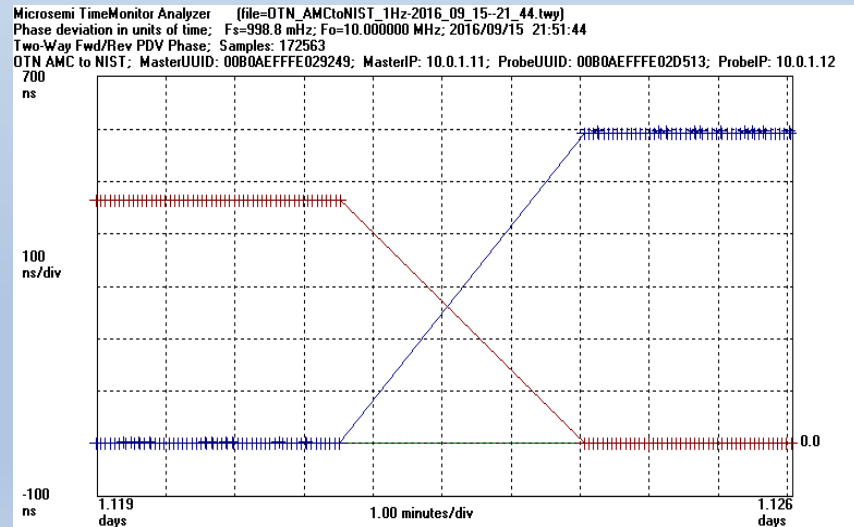


# PTP fiber vs. GPS Carrier Phase


PTP (blue) and GPS carrier-phase (red) measurements comparing UTC(NIST) and UTC (USNO) sites

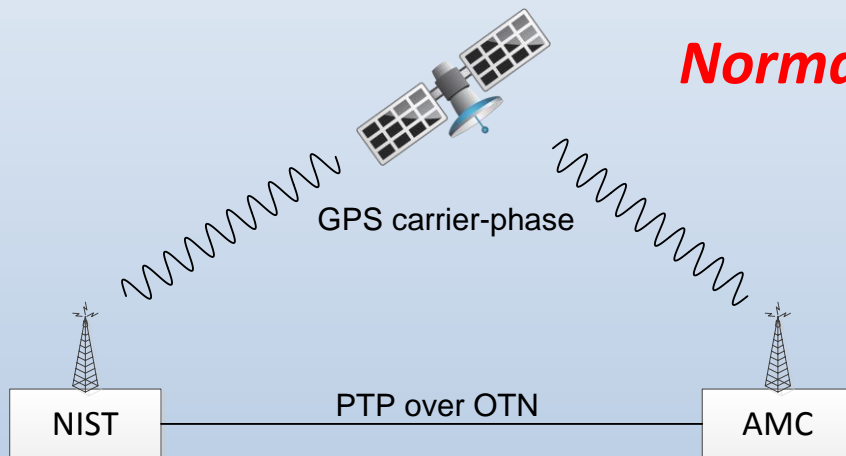

**Normal:**

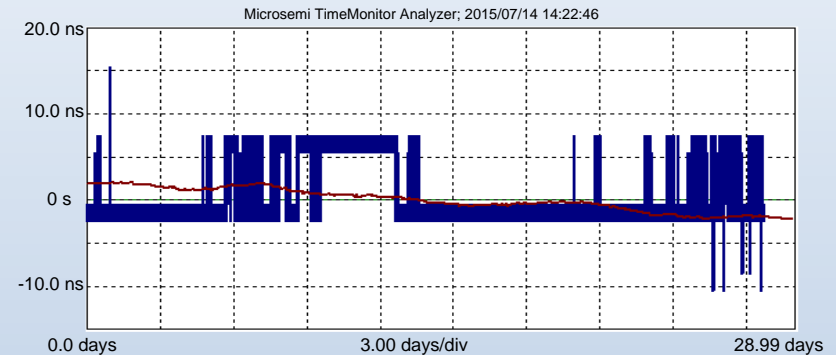

**Failure:**

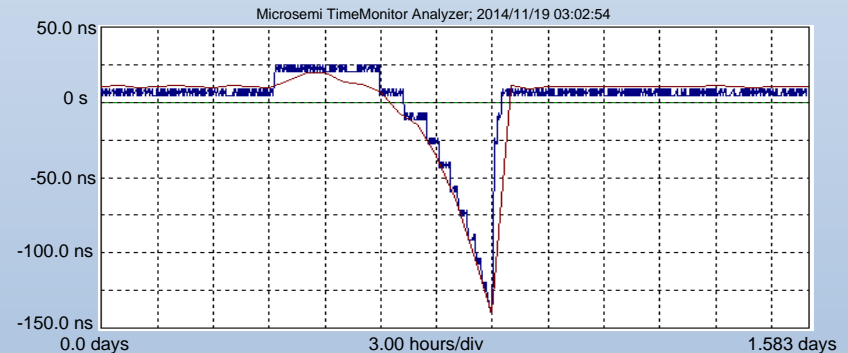

**Normal:** The two measurements generally match though the timestamp resolution of the PTP equipment does not have the precision to show the sub-nanosecond movement


**Failure:** The two measurements match well with the 180 ns excursion occurring over the 12-hour period of timing distribution equipment failure at one of the UTC sites. The PTP timestamp resolution can be seen in the 4 nanosecond quantization and 16 nanosecond steps.

# Long-term PTP Fiber Measurement

Two-way time error calculation on 95-day measurement shows 26 ns peak-to-peak over the entire run

*These results support the possibility that this method could provide time holdover below 100 ns indefinitely*


Microsemi TimeMonitor Analyzer (file=OTN\_AMCtoNIST\_2015\_07\_14-22\_46\_1ppm\_cumulative\_95d.twj)  
Phase deviation in units of time: Fs=15.96 MHz; Fo=10.000000 MHz; 2015/07/14 22:48:25  
Two-Way Time Error Phase; Samples: 130632; Initial phase offset: 21.0520 usec; OTN AMC to NIST 64Hz;

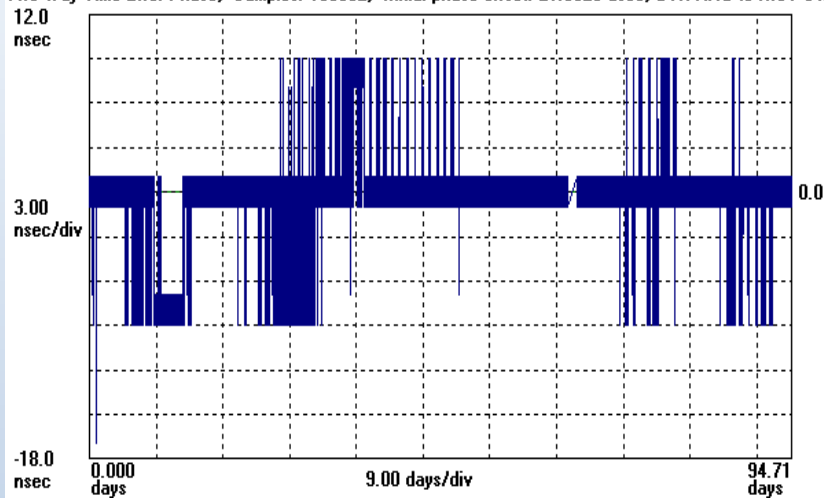

MDEV calculation on 95-day PTP fiber measurement

*The Modified Allan Deviation shows the capability of frequency transfer approaching 1 part in  $10^{15}$  at 10 days*

MDEV vs.  $\tau$

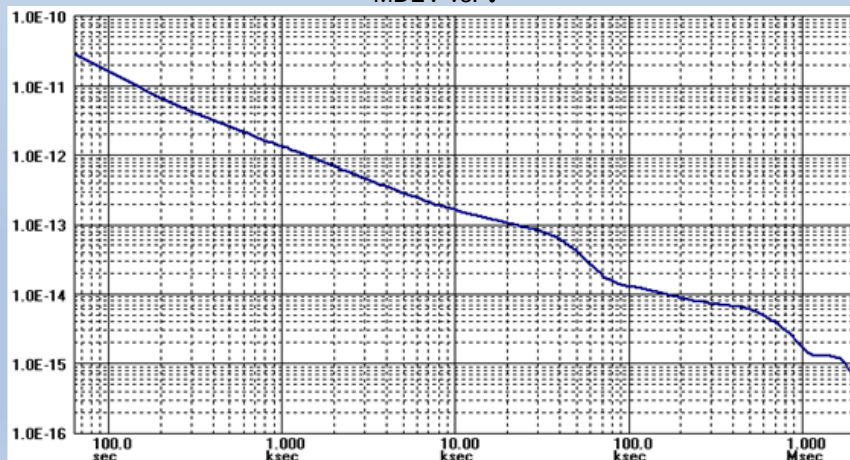


# Solving Asymmetry - APTS


G.8275.2 “Precision time protocol telecom profile for time/phase synchronization with partial timing support from the network”

- Published document released August 2016
- Includes “assisted partial timing support” which uses GNSS to calibrate out asymmetry

Raw data 87 day measurement  
has constant 21  $\mu$ s bias

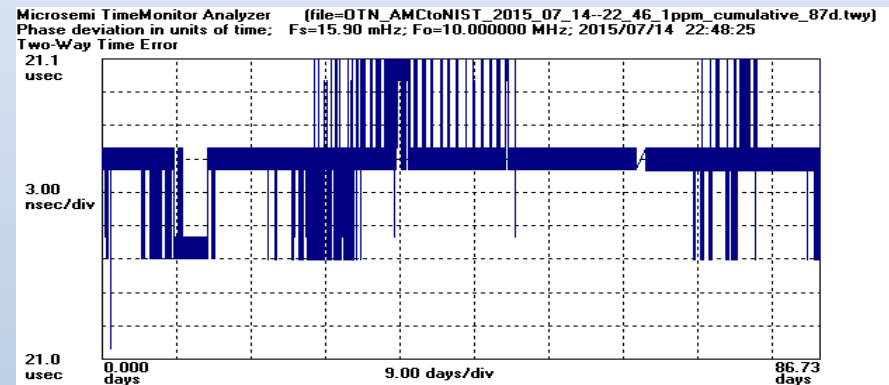

With APTS, the constant 21  $\mu$ s bias  
is corrected for and removed

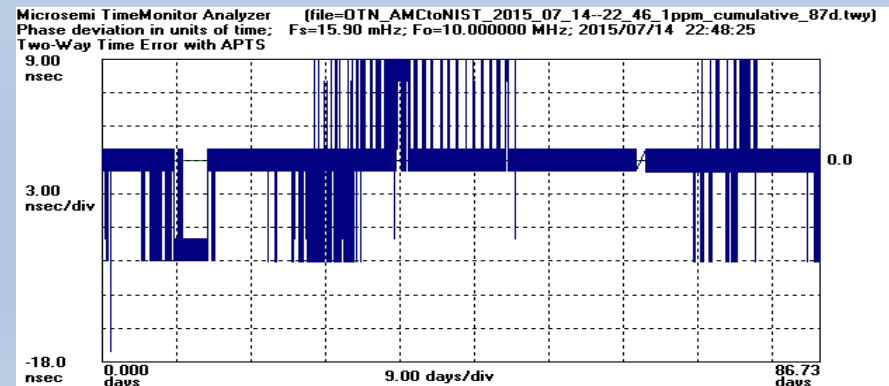


# Next Phase: Long-range Circuit (Early 2017)

Current: Boulder (NIST) to Schriever (USNO) **150 km**



Next phase: Boulder (NIST) to Chicago **1700 km**

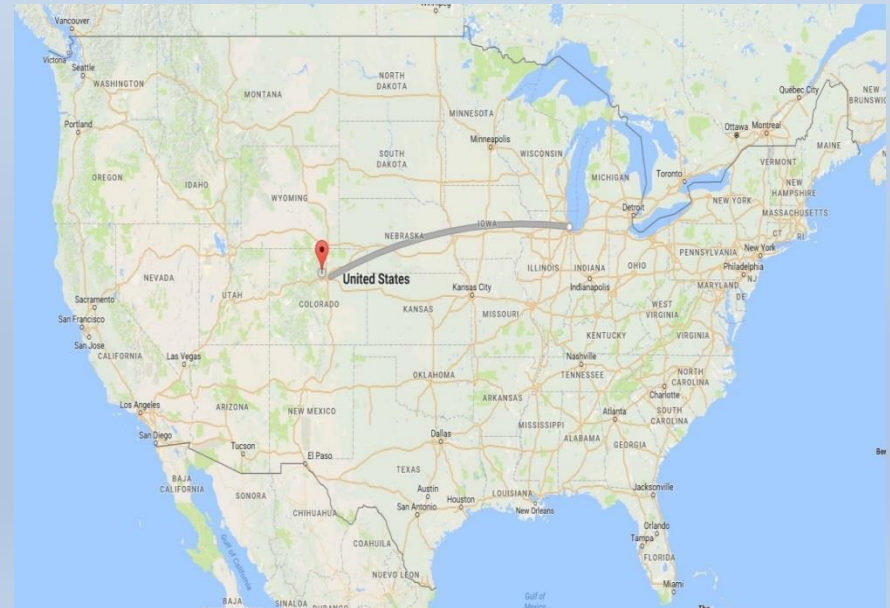

Thank You for Your Attention